Floor Plan

3.02.02 C
Two Bedroom (Mob)

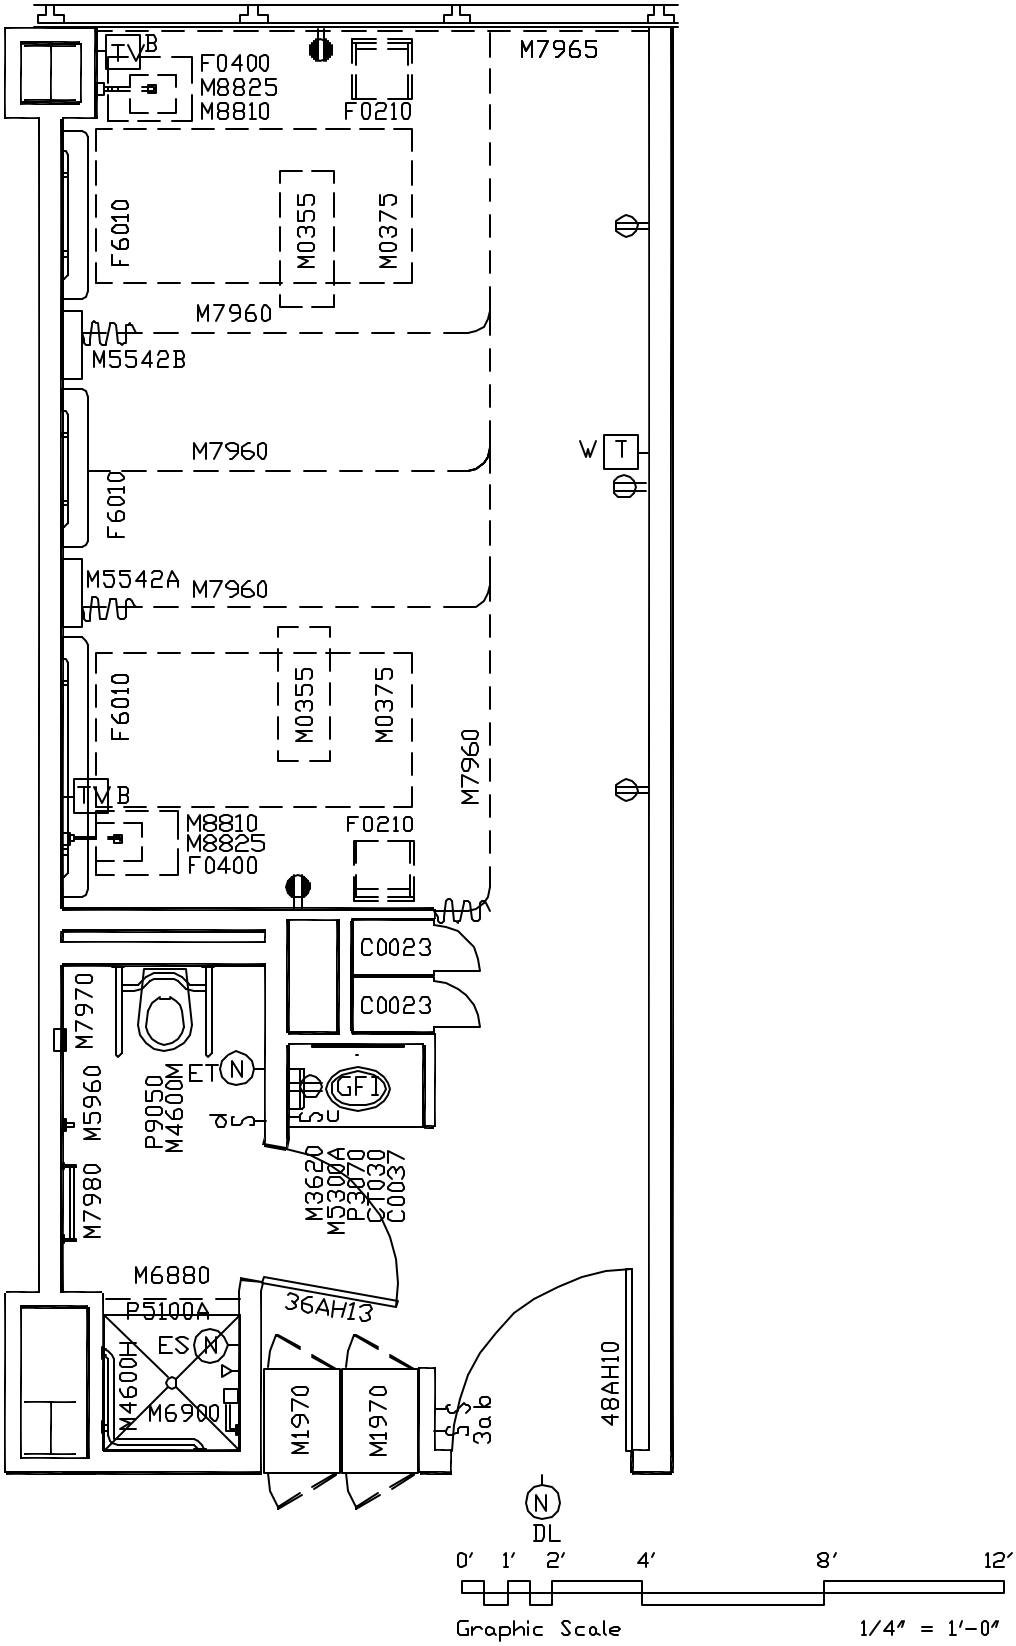

JULY 1988

Reflected Ceiling Plan

3.02.02 D
Two Bedroom (Mob)

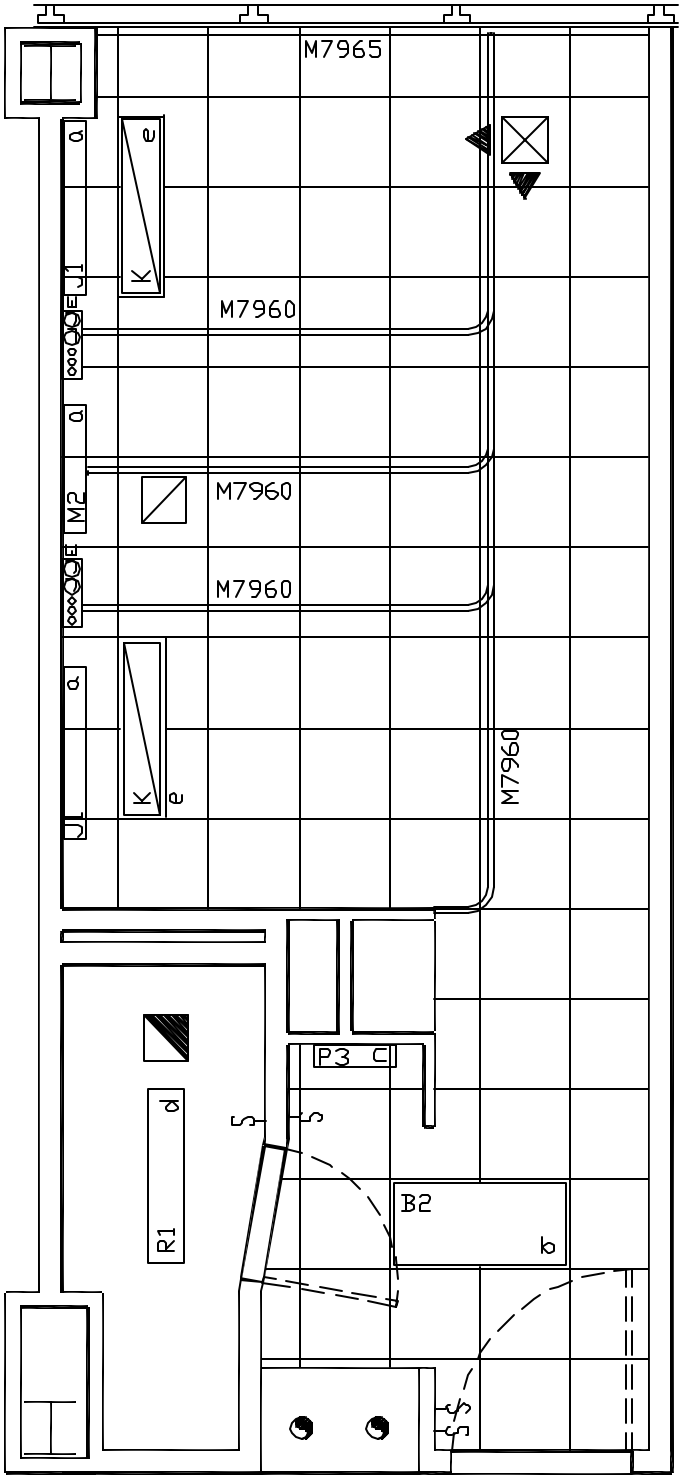

0′ 1′ 2′ 4′ 8′ 12′
Graphic Scale 1/4″ = 1′-0″

JULY 1988

Functional Diagram

3.02.02 B
Two Bedroom (Mob)

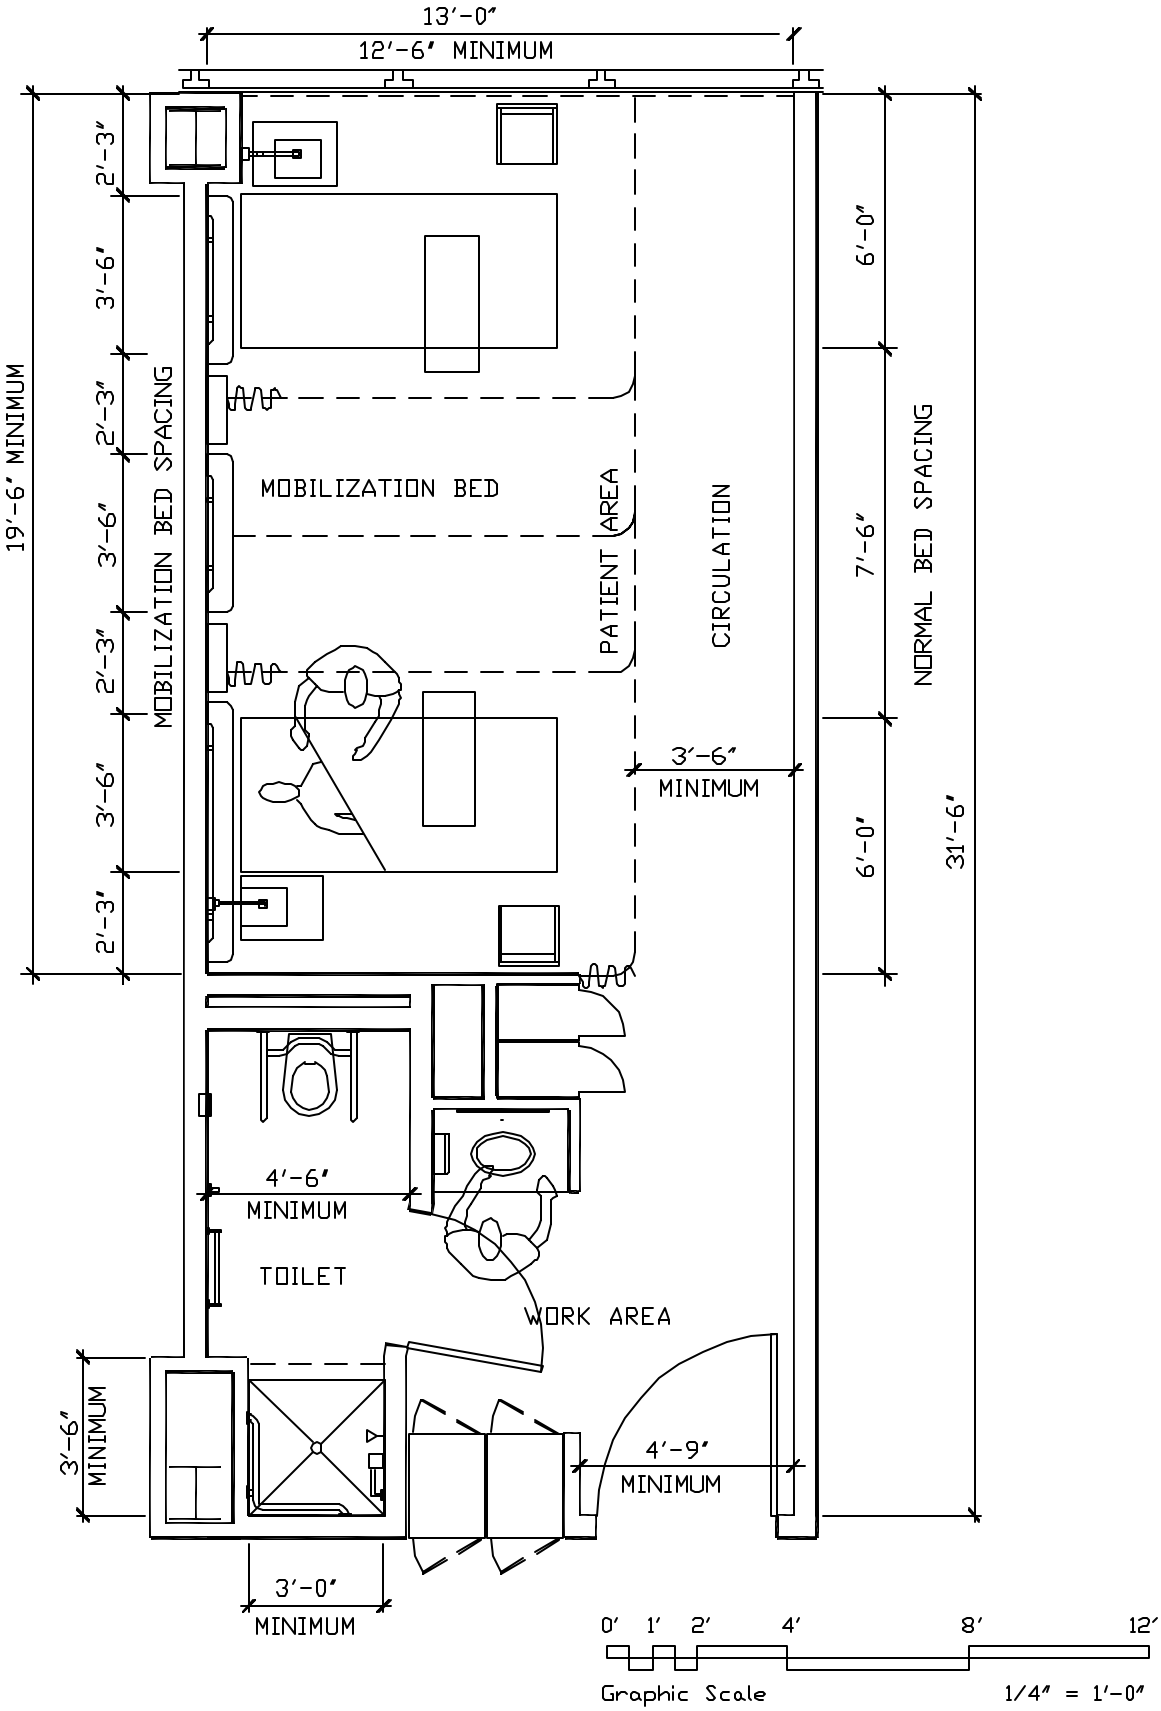

JULY 1988

Composite Plan

3.02.02 E
Two Bedroom (Mob)

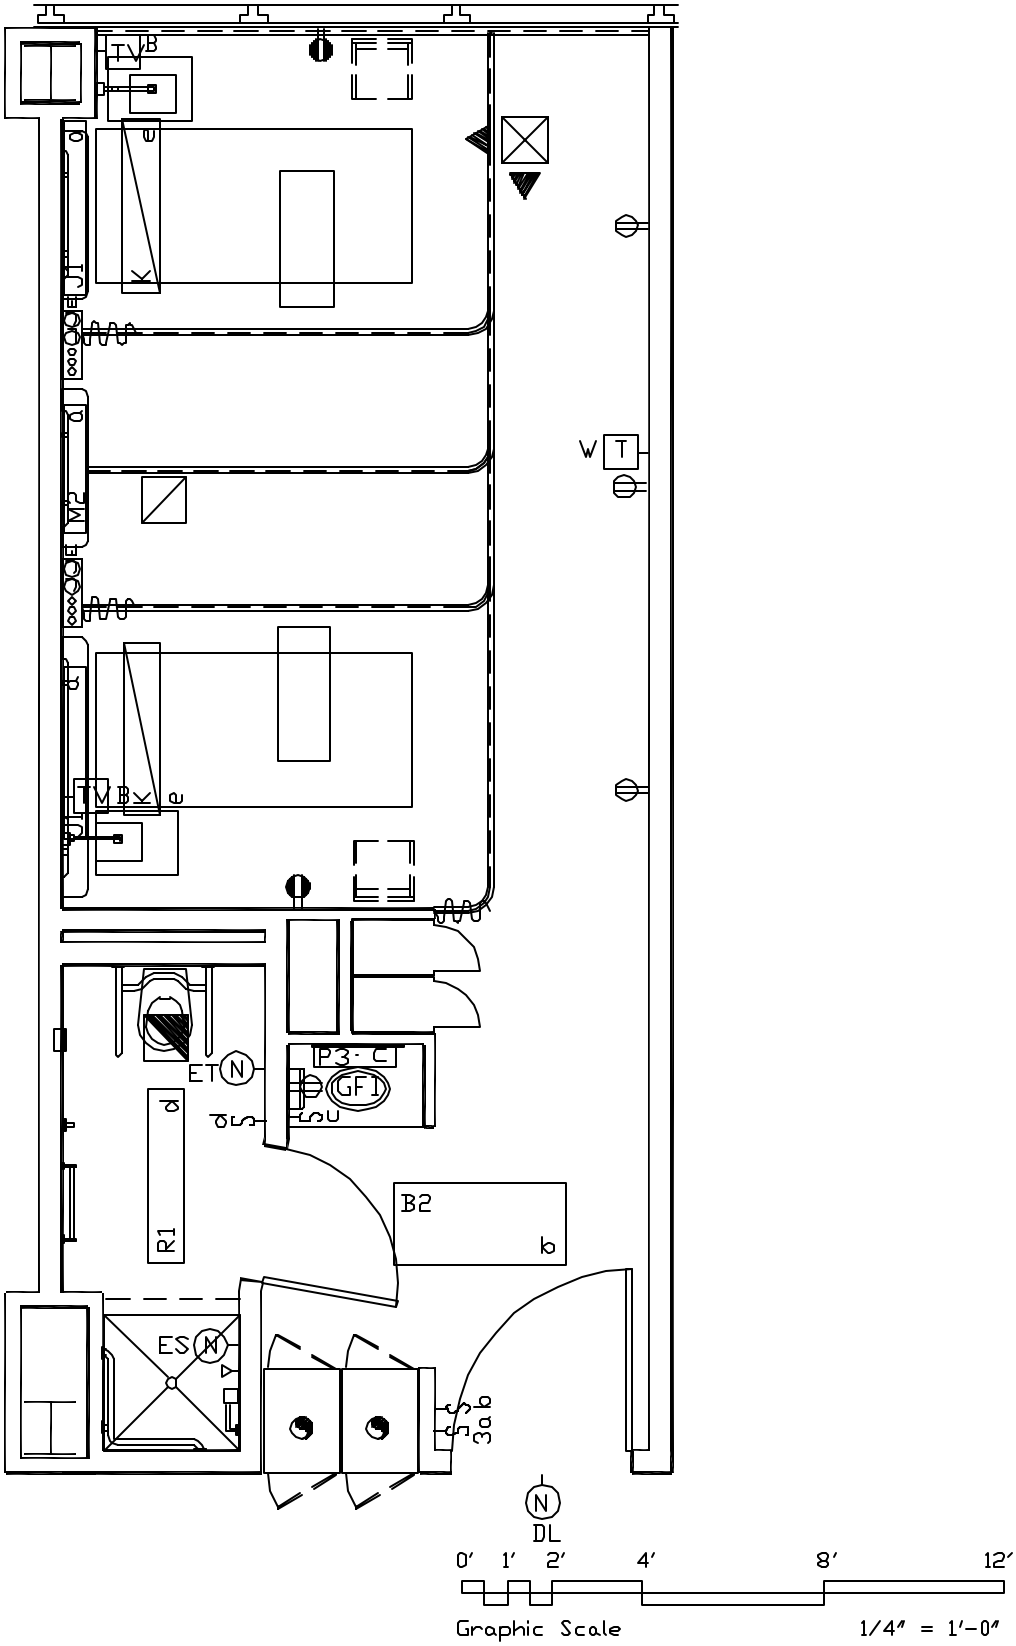

JULY 1988

Matrix Data

3.02.02 A
Two Bedroom (Mob)

ARCHITECTURAL/ACOUSTICS

Square Foot Area Net - (1) Bedroom - 250
(2) Toilet - 60

Finishes - Walls - (1) GW (2) GW-SG
- Base - (1) R (2) CT
- Floor - (1) VCT(2) CT
- Ceiling - (1) ACT(2) GW

Ceiling Ht - (1) 8'-0"
(2) 8'-0"

Door Size & Type - (1) 48A (2) 36A
Hardware Set - (1) H10 (2) H13
Ambient Noise Level - (1) NC30-35 (2) NC35-40
Speech Privacy Level - (1) Normal (2) Normal

Architectural Notes - (1) 7,25
ref. pp. 5-6

ELECTRICAL

Ambient Illum (FC) - (1) 10 (2) 20
Task Illum (FC) - (1) Reading - 30
Luminare Type - (1) B2,J1,M2,K,P3
(2) R1

Switching - (1) Multi-Sw & Std by Area
(2) Std

Electrical Notes - (1) 12,14,16,38
ref. pp. 20-23

MECHANICAL

Total Air Changes - (1) 4 (2) 10
Outside Air Changes - (1) 1 (2) 0
Room Pressure(%) - (1) 0 (2) -100
Temperature (F) - (1) Sum 78 Win 70
(2) Sum - Win -

Relative Hum(%) - (1) 30-60
(2) -

Exhaust Air - (1) No (2) Yes
Return Air - (1) Yes (2) No
Filtration(%) - (1) 25,80,0 (2) -

Mechanical Notes - (2) 6
ref. pp. 13-15

MECHANICAL PIPING

Cold Water - Yes
Hot Water - Yes
Treated Water - No
Chilled Water - No
Waste/Vent - Yes
Floor Drain - No
Steam - No
Condensate - No

	Qty
M5542A	1
M5542B	1

Piping Notes - (1) 5
ref.pp. 16

EQUIPMENT PROGRAM

J.S.N. Code	Nomenclature	Qty	Log Cat
C0023	Wardrobe, Single	2	A
C0037	Apron Frame 22" D x 36" L	1	A
CT030	Counter Top - P.L.	1	A
F6010	Bumper, Hospital Bed	3	A
M1970	Nurse Server	2	A
M3620	Dispenser, Paper Towel	1	A
M4600H	Grab Bar, Shower	1	A
M4600M	Grab Bar, Straddle	1	A
M5300A	Mirror 24 X 30	1	A
M5542A	Patient SVC Console - M/S	1	A
M5542B	Patient SVC Console - M/S	1	A
M5960	Coat Hook	1	A
M6880	Shower Curtain & Rod	1	A
M6900	Soap Dish w/ Grab Bar	1	A
M7960	Track & Curtain, Cubicle	4	A
M7965	Drapery Track	1	A
M7970	Toilet Paper Holder, Recessed	1	A
M7980	Towel Bar, 18"	1	A
P3070	Lavatory, Counter	1	A
P5100A	Shower 3'-6"x3'	1	A
P9050	Water Closet	1	A
M8825	Bracket, Tv	2	B
F0210	Chair, Visitor	2	C
F0400	Cabinet, Bedside	2	C
M0355	Table, Overbed	2	C
M0375	Bed, Hosp., Electric	2	C
M8810	Television, Bedside	2	C

COMMUNICATION PROGRAM

Commo Code	Nomenclature	Qty	Log Cat
NC001	Single Patient Station	1	A
NC002	Dual Patient Station	1	A
NC0DL	Dome Light - 3 Lamp	1	A
NC0ES	Pullcord Station-WP, Shower	1	A
NC0ET	Pullcord Station, Emer	1	A
TL00H	Service Console Outlet-54" AFB		A
TS00W	Wall Outlet-36" AFF	1	A
TV00B	Wall Outlet, Bedside-48" AFF	2	A

Communication Notes - 17
ref. pp. 29-30

Matrix Data

3.02.02 A2
Two Bedroom (Mob)

COMMUNICATION PROGRAM

Commo Code	Nomenclature	Qty	Log Cat
-	-	-	-

MATRIX SHEET 2 SHOULD ONLY BE USED
IF REQUIRED BY MATRIX SHEET 1 CONTENT OVERFLOW