Floor Plan

3.02.07 C
Ped-Two Bedroom (Mob)

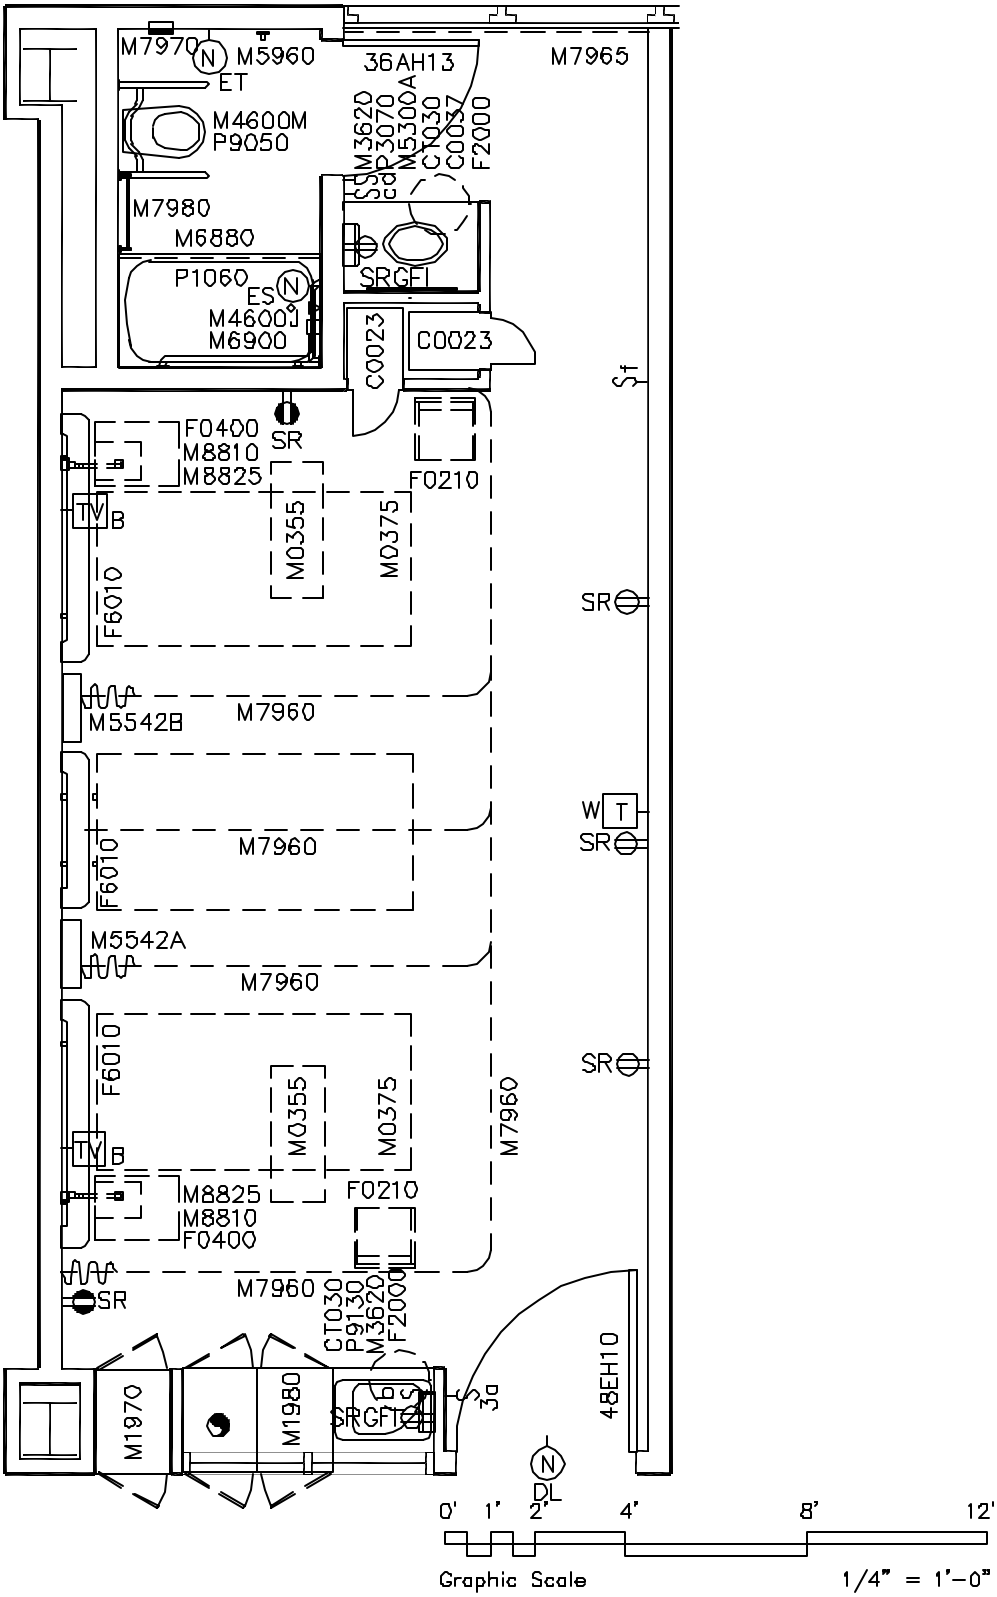

JULY 1988

Reflected Ceiling Plan 3.02.07 D
Ped-Two Bedroom (Mob)

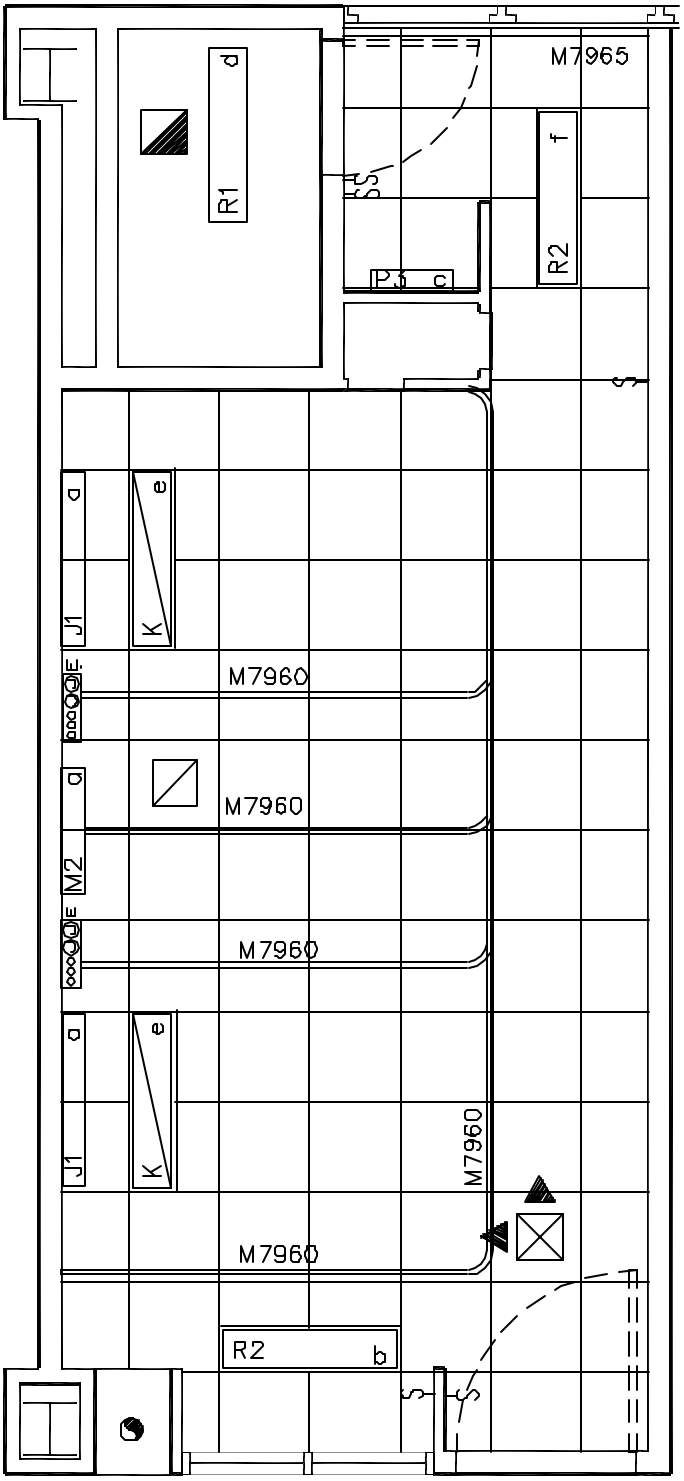

0' 1' 2' 4' 8' 12'

Graphic Scale 1/4" = 1'-0"

JULY 1988

Functional Diagram 3.02.07 B

Ped–Two Bedroom (Mob)

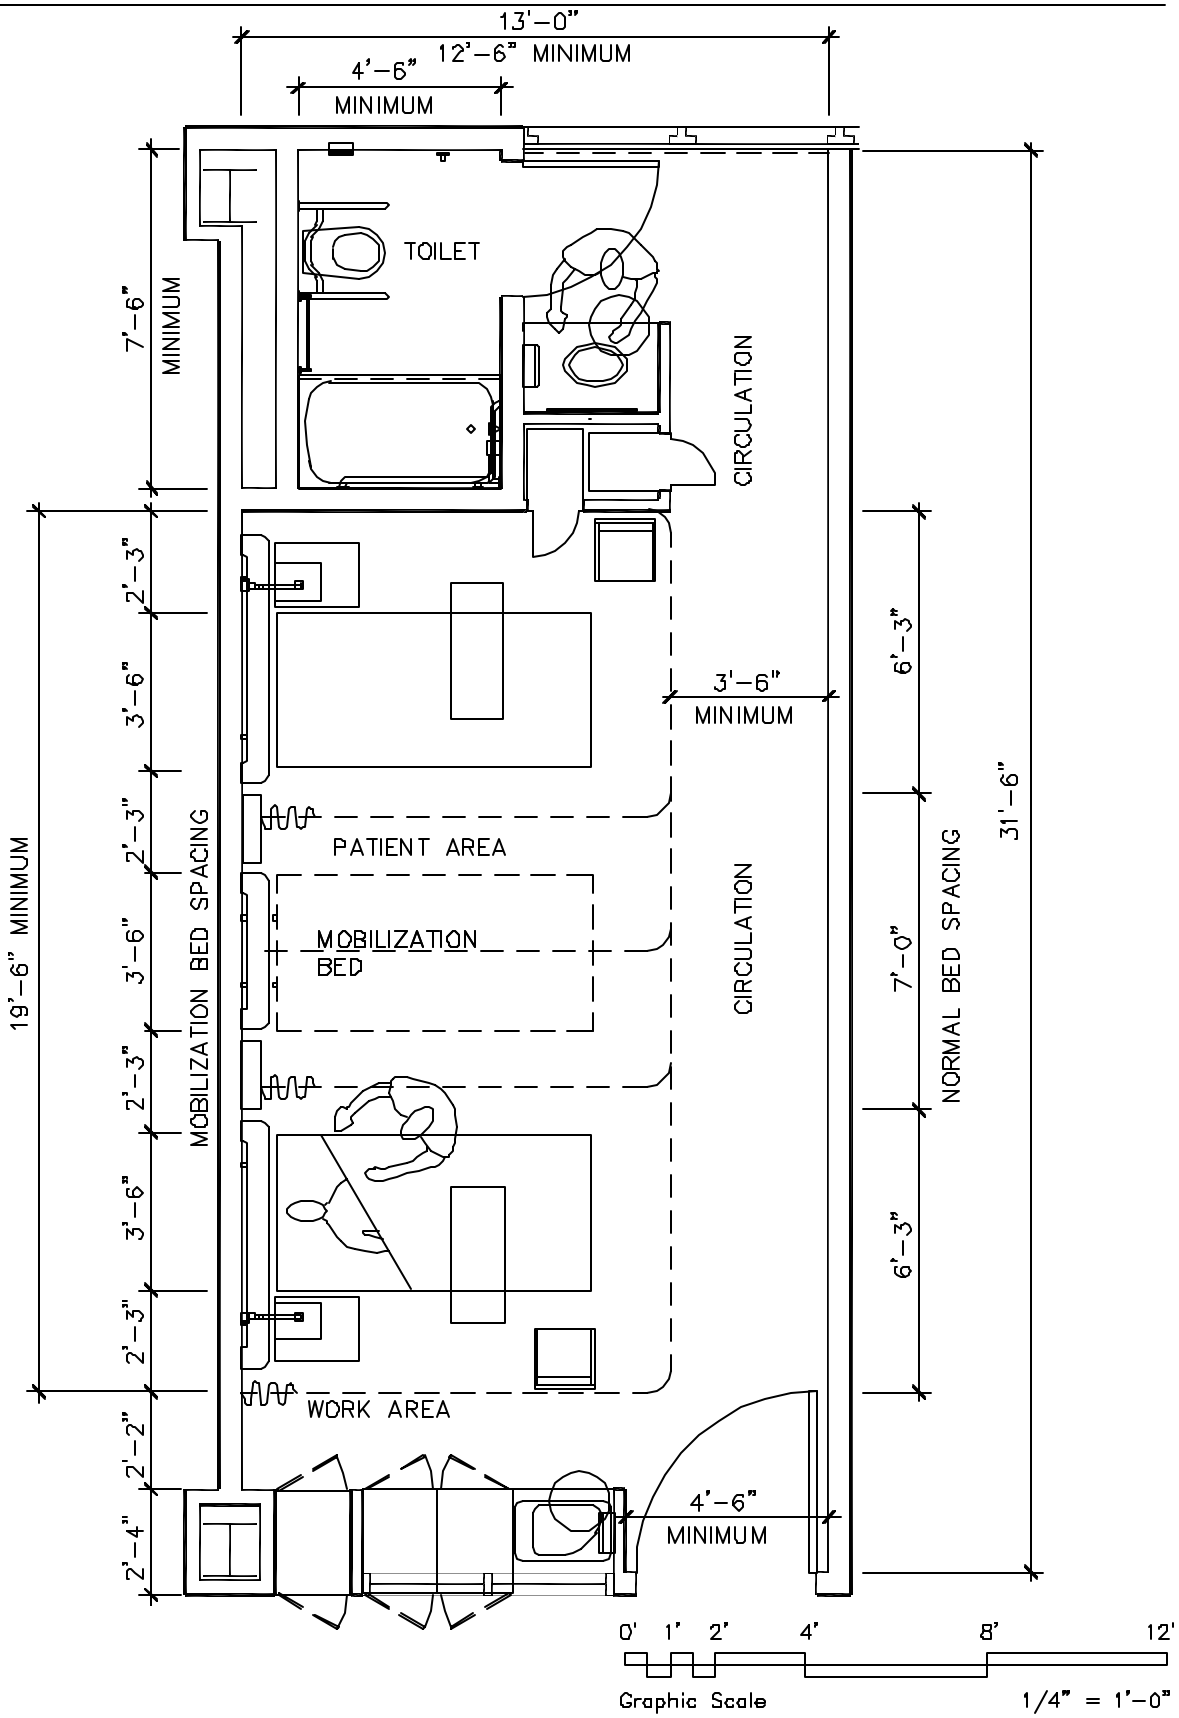

JULY 1988

Composite Plan

3.02.07 E
Ped-Two Bedroom (Mob)

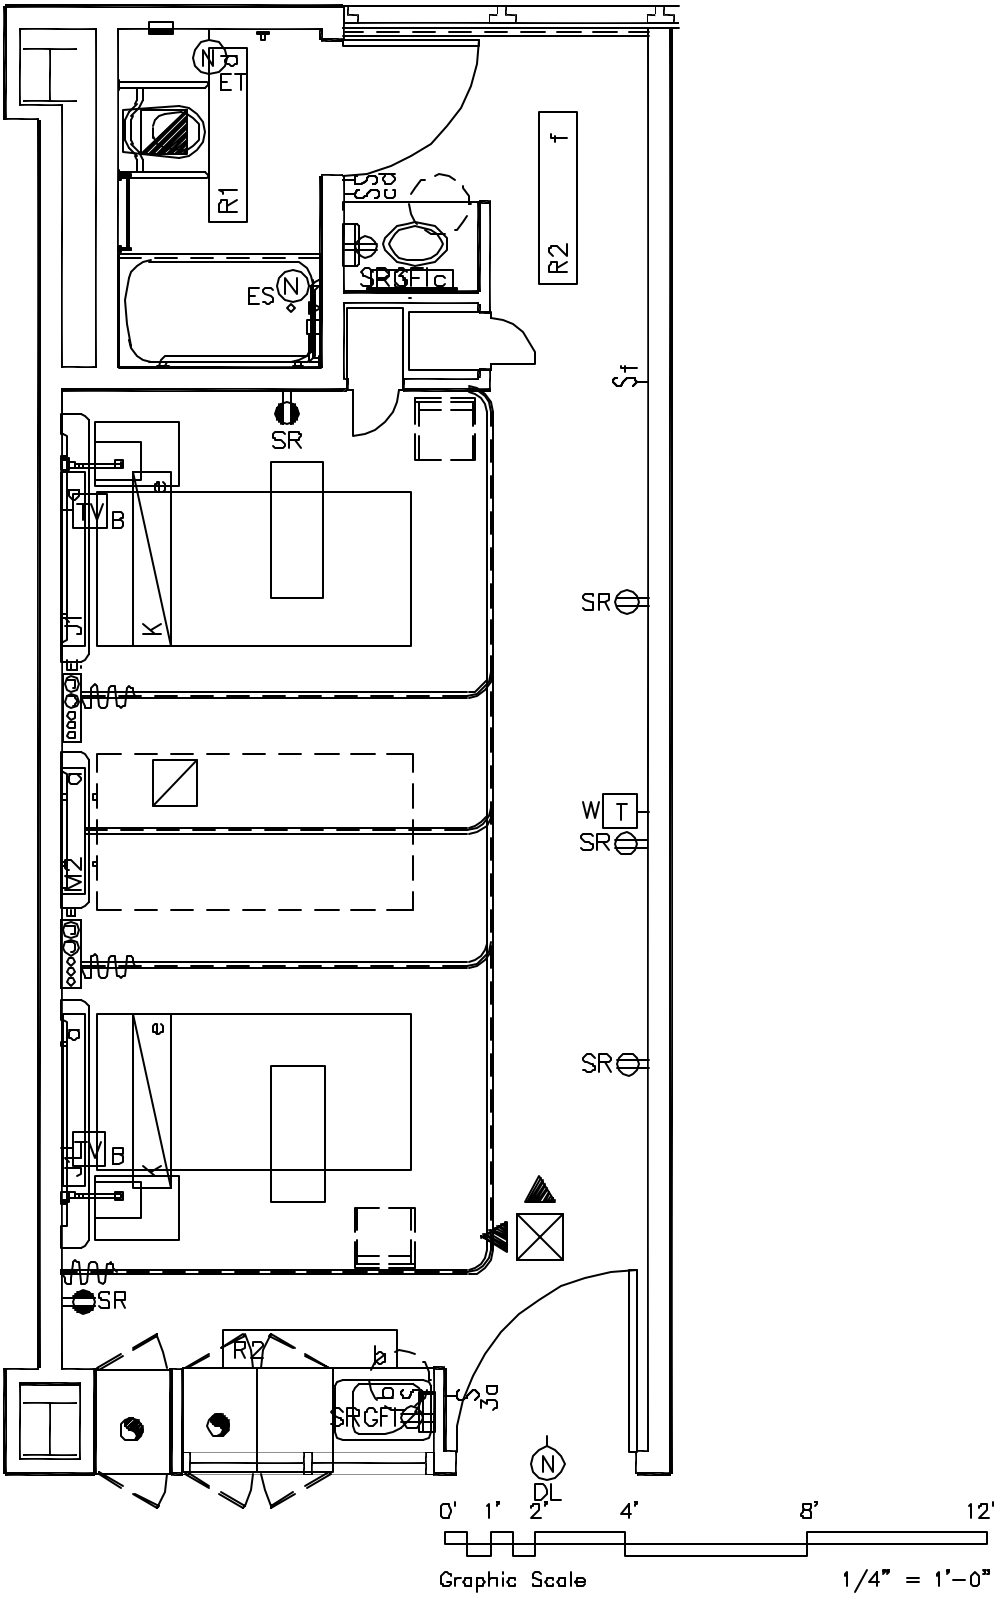

JULY 1988

Matrix Data

3.02.07 A
Ped–Two Bedroom (Mob)

ARCHITECTURAL/ACOUSTICS

Square Foot Area Net	–	(1) Bedroom – 250	
		(2) Toilet – 60	
Finishes – Walls	–	(1) GW	(2) GW–SG
– Base	–	(1) R	(2) CT
– Floor	–	(1) VCT	(2) CT
– Ceiling	–	(1) ACT	(2) GW
Ceiling Ht	–	(1) 8'–0"	
		(2) 8'–0"	
Door Size & Type	–	(1) 48E	(2) 36A
Hardware Set	–	(1) H10	(2) H13
Ambient Noise Level	–	(1) NC30–35	(2) NC35–40
Speech Privacy Level	–	(1) Normal	(2) Normal
Architectural Notes	–	(1) 11,25	
		ref. pp. 5–6	

ELECTRICAL

Ambient Illum (FC)	–	(1) 10	(2) 20
Task Illum (FC)	–	(1) Reading–30	
Luminare Type	–	(1) J1,K,MZ,P3,R2	
		(2) R1	
Switching	–	(1) Std by Area	
		(2) Std	
Electrical Notes	–	(1) 12,14,15,16,38	
		ref. pp. 20–23	

MECHANICAL

Total Air Changes	–	(1) 4	(2) 10		
Outside Air Changes	–	(1) 1	(2) 0		
Room Pressure(%)	–	(1) 0	(2) –100		
Temperature (F)	–	(1) Sum 78		Win	70
		(2) Sum –		Win	–
Relative Hum(%)	–	(1) 30–60			
		(2) –			
Exhaust Air	–	(1) No		(2)	Yes
Return Air	–	(1) Yes		(2)	No
Filtration(%)	–	(1) 25,80,0		(2)	–
Mechanical Notes	–	(1) 15		(2)	6
		ref. pp. 13–15			

MECHANICAL PIPING

Cold Water	–	Yes		
Hot Water	–	Yes		Qty
Treated Water	–	No		
Chilled Water	–	No	M5542A	– 1
Waste/Vent	–	Yes	M5542B	– 1
Floor Drain	–	No		
Steam	–	No		
Condensate	–	No		
Piping Notes	–	(1) 5		
		ref. pp. 16		

EQUIPMENT PROGRAM

J.S.N. Code	Nomenclature	Qty	Log Cat
C0023	Wardrobe, Single	2	A
C0037	Apron Frame 22" D x 36" L	1	A
CT030	Counter Top – P.L.	2	A
F6010	Bumper, Hospital Bed	3	A
M1970	Nurse Server	1	A
M1980	Nurse Server U/C	1	A
M3620	Dispenser, Paper Towel	2	A
M4600J	Grab Bar,Tub/Shower	1	A
M4600M	Grab Bar, Straddle	1	A
M5300A	Mirror 24 X 30	1	A
M5542A	Patient SVC Console – M/S	1	A
M5542B	Patient SVC Console – M/S	1	A
M5960	Coat Hook	1	A
M6880	Shower Curtain and Rod	1	A
M6900	Soap Dish w/ Grab Bar	1	A
M7960	Track & Curtain, Cubicle	4	A
M7965	Drapery Track	1	A
M7970	Toilet Paper Holder, Recessed	1	A
M7980	Towel Bar, 18"	1	A
P1060	Bath Tub, Childs	1	A
P3070	Lavatory, Counter	1	A
P9050	Water Closet	1	A
P9130	Bath Sink, Infant	1	A
M8825	Bracket, Tv	2	B
F0210	Chair, Visitor	2	C
F0400	Cabinet, Bedside	2	C
F2000	Waste Receptacle, Off	2	C
M0355	Table, Overbed	2	C
M0375	Bed, Hosp., Electric	2	C
M8810	Television, Bedside	2	C

COMMUNICATION PROGRAM

Commo Code	Nomenclature	Qty	Log Cat
NC001	Single Patient Station	1	A
NC002	Dual Patient Station	1	A
NC0DL	Dome Light – 3 Lamp	1	A
NC0ES	Pullcord Station–WP, Shower	1	A
NC0ET	Pullcord Station, Emer	1	A
TL00H	Service Console outlet–36" AFF	2	A
TS00W	Wall Outlet–36" AFF	1	A
TV00B	Wall Outlet, Bedside–48" AFF	2	A

Communication Notes – 17
ref. pp. 29–30

Matrix Data

3.02.07 A2
Ped-Two Bedroom (Mob)

COMMUNICATION PROGRAM

Commo Code	Nomenclature	Qty	Log Cat
-	-	-	-

MATRIX SHEET 2 SHOULD ONLY BE USED
IF REQUIRED BY MATRIX SHEET 1 CONTENT OVERFLOW