

NOTES

1. PROVIDE INFANT THEFT SECURITY SYSTEM AS REQUIRED BY USING MILITARY DEPARTMENT.
2. EITHER PLATE 4.02.02 OR 4.02.03 MAY BE USED FOR A LDR OR LDRP. VERIFY WITH USER.

KEY NOTES

1. MOUNT 1-A5145, HOOK, AT 1372 [4'-6"] AFF AND 1-A5145 AT 1524 [5'-0"] AFF.
2. PROVIDE A5030, BENCH, FOR NAVY PROJECTS. TERMINATE A5110, GRAB BAR, ABOVE BENCH LOCATION.
3. PROVIDE A5109 AND A5110, GRAB BARS, THAT COMPLY WITH ADA.
4. BASEBOARD RADIATOR MAY OCCUR AT EXTERIOR WALL.
5. SEE ELEVATIONS OF F0550, RESUSCITATION ARMOIRE, AND A1110, HEADWALL, FOR UTILITIES.
6. P3200, ELECTRONIC LAVATORY, MAY BE USED INSTEAD OF P3100, LAVATORY. FOR THE P3200 PROVIDE EITHER BATTERY POWER OR HARD WIRED CONNECTION.
7. COORDINATE LOCATIONS OF ELECTRICAL AND DATA OUTLETS WITH M1802, WALL MOUNTED, FOLD DOWN COMPUTER.
8. WHERE FEASIBLE, SLOPE TOILET ROOM FLOOR TOWARDS THE SHOWER.
9. MOUNT 1-A5165, SHELF, AT 1219 [4'-0"] AFF AND 1-A5165 AT 1524 [5'-0"] AFF.
10. MOUNT A5145, HOOK, AT 1219 [4'-0"] AFF.
11. PROVIDE M7445, SURGICAL LIGHT, INSTEAD OF M7515, SURGICAL LIGHT, FOR AIR FORCE PROJECTS. LIGHT REQUIRES BATTERY BACKUP OR UPS.

L & D - LDR/LDRP (Narrow) (LDRP1) 4.02.02

LABOR & DELIVERY/OB UNIT


0 1000 2000

FLOOR/EQUIPMENT PLAN



DATE: 01/28/2002

1:50 SCALE (MILLIMETERS)

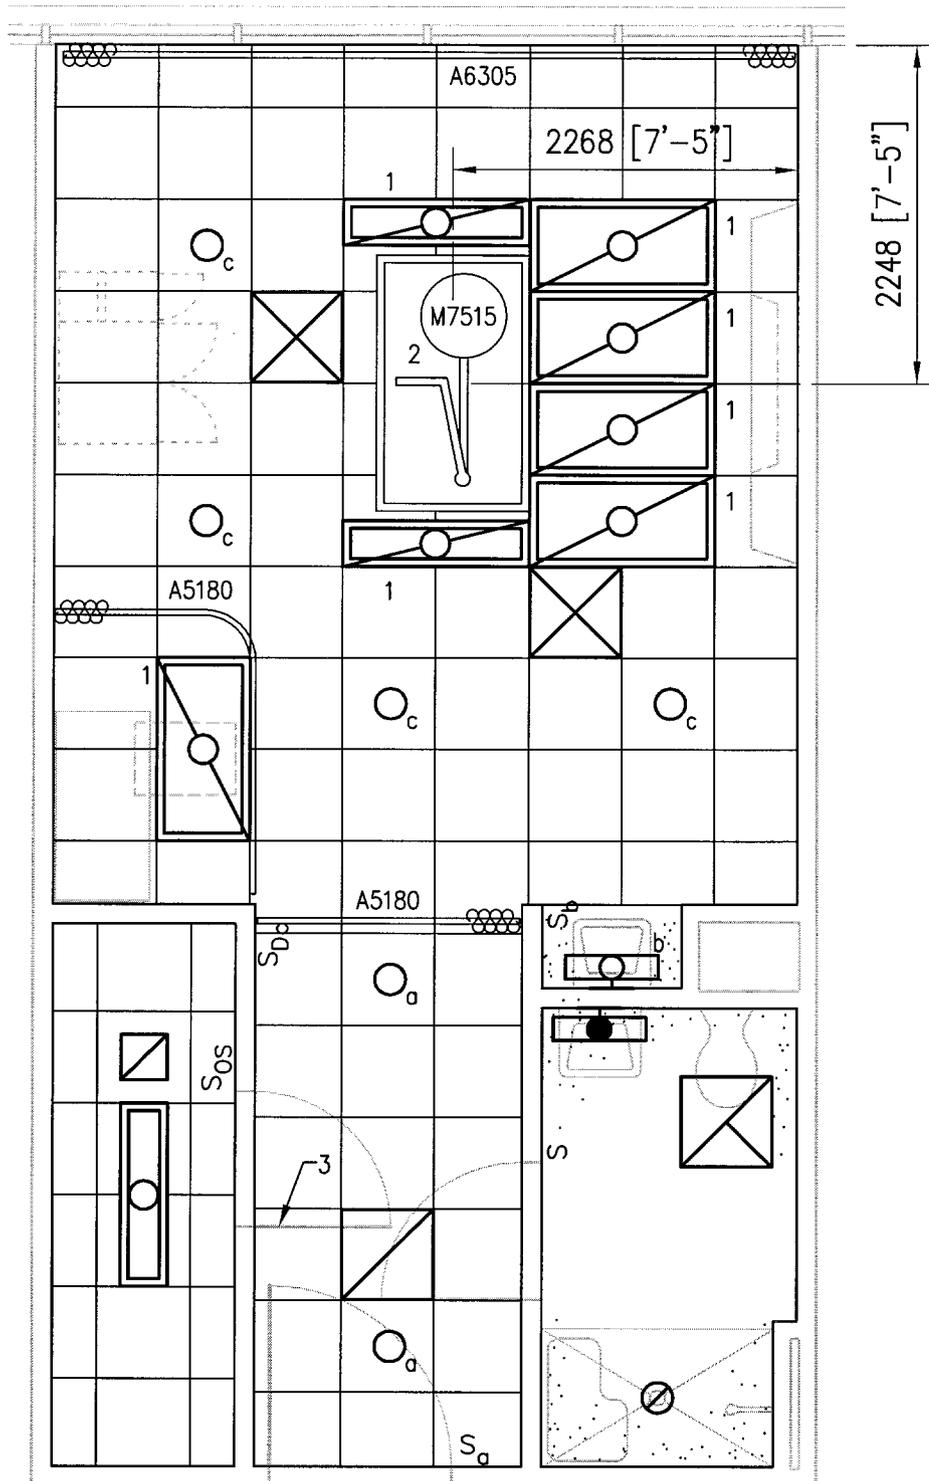

KEY NOTES

1. LIGHT FIXTURE IS CONTROLLED BY SWITCH LOCATED IN A1110, PREFABRICATED HEADWALL. SEE HEADWALL ELEVATION FOR SWITCH LOCATION.
2. PROVIDE M7445, SURGICAL LIGHT, INSTEAD OF M7515, SURGICAL LIGHT, FOR AIR FORCE PROJECTS.
3. UNDERCUT THIS DOOR.

L & D - LDR/LDRP (Narrow) (LDRP1) 4.02.02

LABOR & DELIVERY/OB UNIT


0 1000 2000

CEILING PLAN




DATE: 01/28/2002

1:50 SCALE (MILLIMETERS)

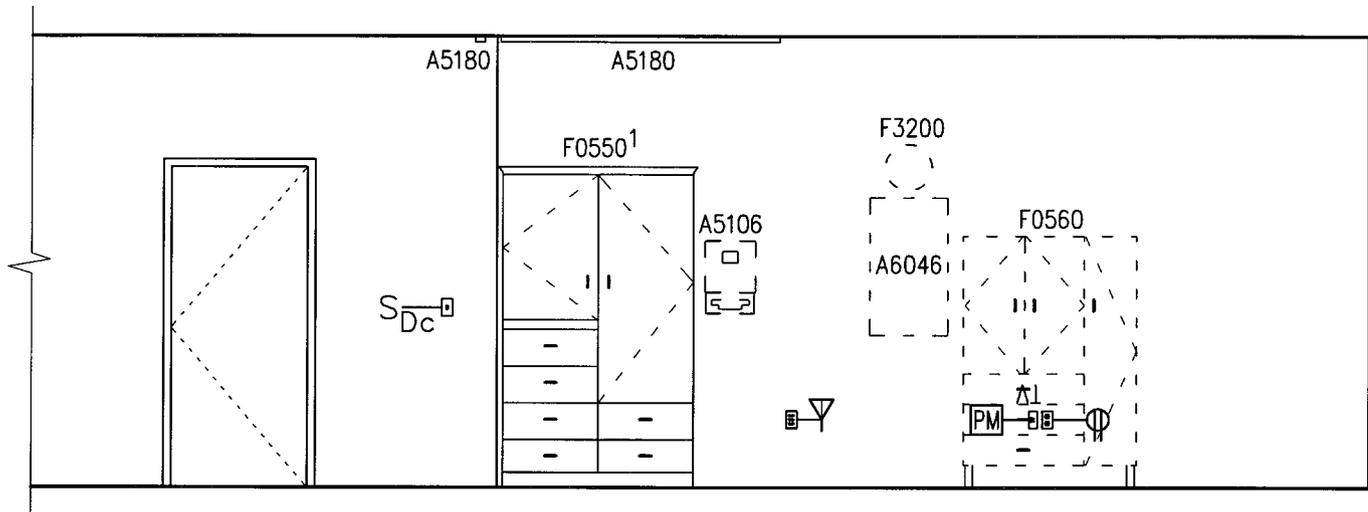

WEST

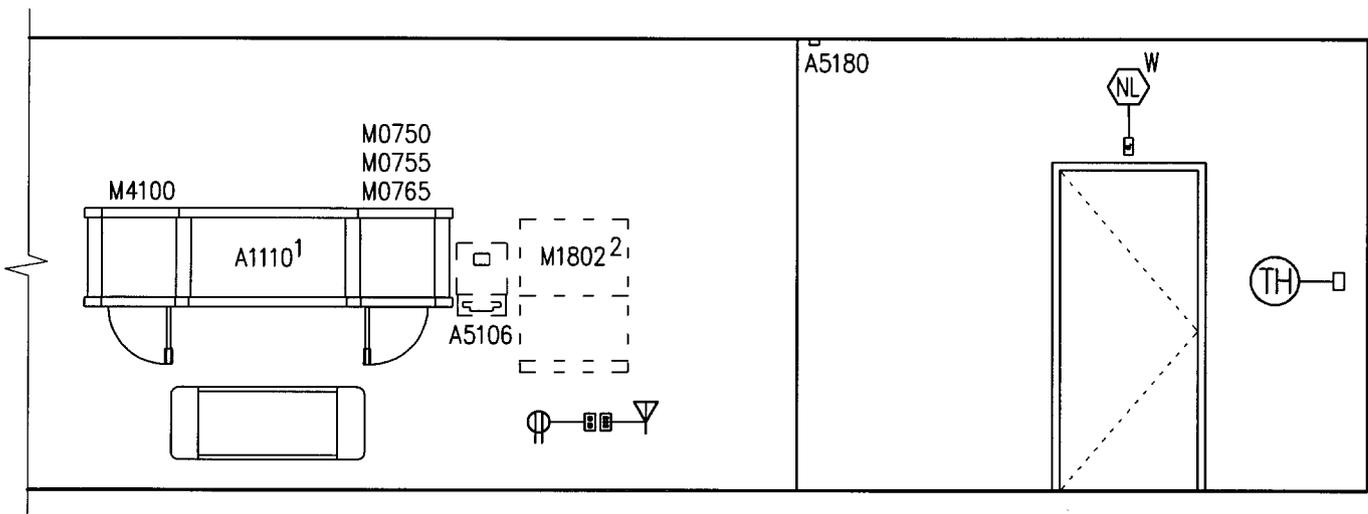

EAST

NOTES

1. SEE TYPICAL EQUIPMENT MOUNTING HEIGHTS BEGINNING ON SHEET 7.01.01.

KEY NOTES

1. SEE ELEVATIONS OF F0550, RESUSCITATION ARMOIRE, AND A1110, HEADWALL, FOR UTILITIES.
2. COORDINATE LOCATIONS OF ELECTRICAL AND DATA OUTLETS WITH M1802, WALL MOUNTED, FOLD DOWN COMPUTER.

L & D - LDR/LDRP (Narrow) (LDRP1) 4.02.02

LABOR & DELIVERY/OB UNIT


0 1000 2000

ELEVATIONS




DATE: 01/28/2002


1:50 SCALE (MILLIMETERS)

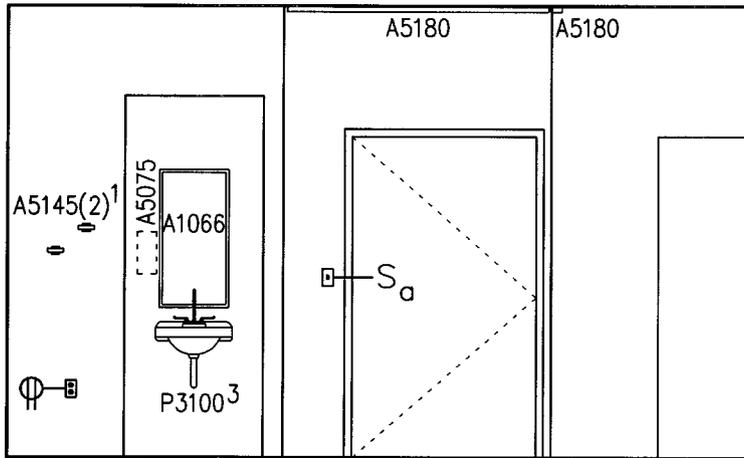


SOUTH

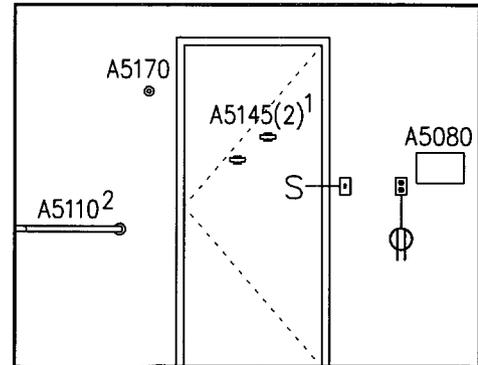


WEST (BATHROOM)⁴

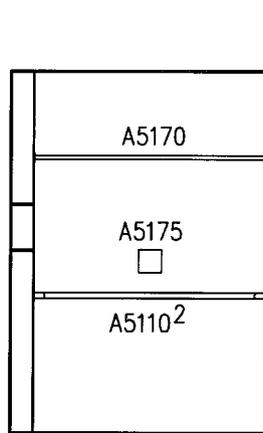

SOUTH (BATHROOM)

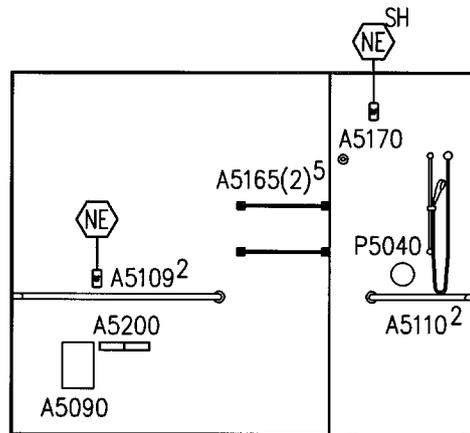

EAST (BATHROOM)⁴

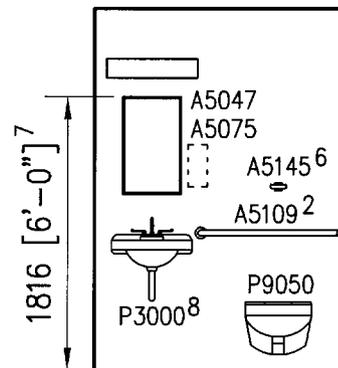

NORTH (BATHROOM)

NOTES

1. SEE TYPICAL EQUIPMENT MOUNTING HEIGHTS BEGINNING ON SHEET 7.01.01.

KEY NOTES

1. MOUNT 1-A5145, HOOK, AT 1372 [4'-6"] AFF AND 1-A5145 AT 1524 [5'-0"] AFF.
2. PROVIDE A5109 AND A5110, GRAB BARS, THAT COMPLY WITH ADA.
3. P3200, ELECTRONIC LAVATORY, MAY BE USED INSTEAD OF P3100, LAVATORY. FOR THE P3200 PROVIDE EITHER BATTERY POWER OR HARD WIRED CONNECTION.
4. WHERE FEASIBLE, SLOPE TOILET ROOM FLOOR TOWARDS THE SHOWER.
5. MOUNT 1-A5165, SHELF, AT 1219 [4'-0"] AFF AND 1-A5165 AT 1524 [5'-0"] AFF.
6. MOUNT A5145, HOOK, AT 1219 [4'-0"] AFF.
7. MOUNT A5047, MEDICINE CABINET, WITH BOTTOM OF REFLECTIVE SURFACE AT 1016 [3'-4"] IN 10% OF ALL LDR ROOMS.
8. DO NOT PROVIDE GOOSENECK STYLE FAUCET.

L & D - LDR/LDRP (Narrow) (LDRP1) 4.02.02

LABOR & DELIVERY/OB UNIT


0 1000 2000

ELEVATIONS




DATE: 01/28/2002

1:50 SCALE (MILLIMETERS)

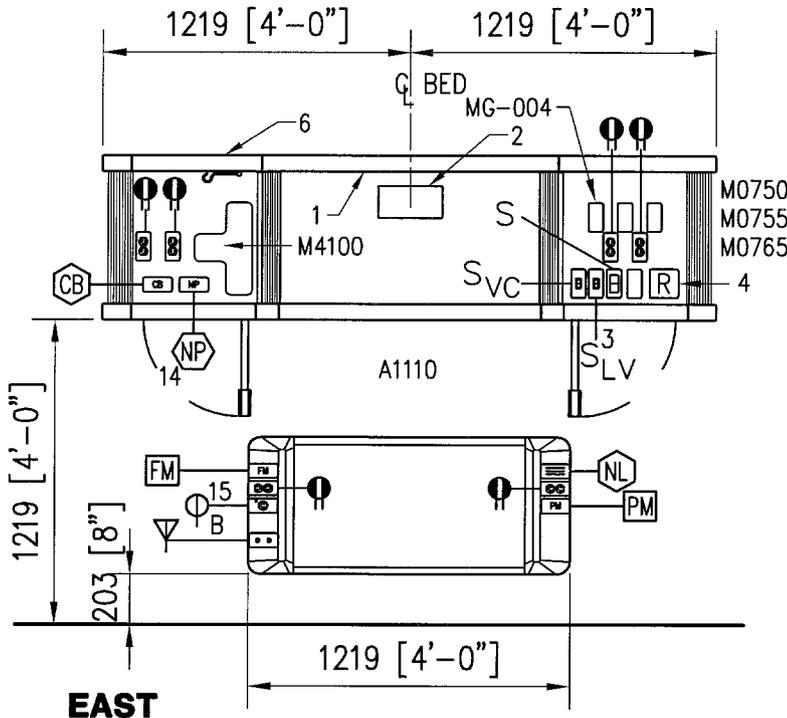

EAST

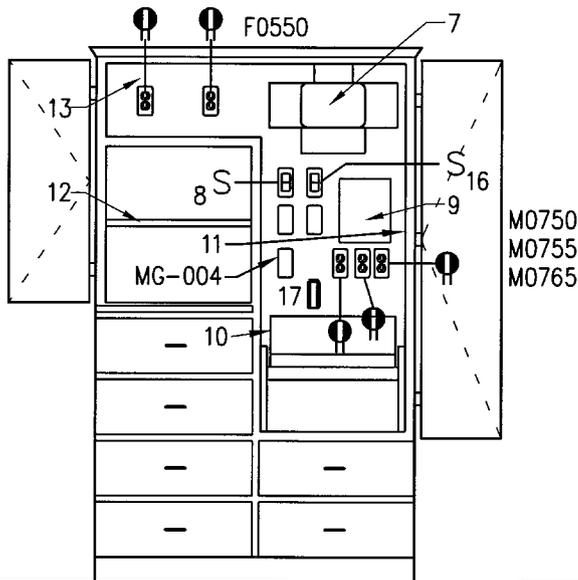

WEST

NOTES

1. RECEPTACLES ON CRITICAL POWER SHALL BE SERVED FROM DIFFERENT CRITICAL POWER TRANSFER SWITCHES.
2. ALL RECEPTACLES IN HEADWALL SHALL BE HOSPITAL GRADE.

KEY NOTES

1. DOWNLIGHT MOUNTED IN HEADWALL.
2. AREA FOR MEDICAL GAS DROPS.
3. THREE POSITION MOMENTARY CONTACT ROCKER SWITCH WITH CENTER "OFF" POSITION. SWITCH CONTROLS UP AND DOWN LIGHT FIXTURES IN HEADWALL VIA LOW VOLTAGE CONTROLLER.
4. LOW VOLTAGE CONTROLLER FOR CONTROL OF UP AND DOWN LIGHTS IN HEADWALL.
5. SWITCH CONTROLS CEILING MOUNTED INCANDESCENT DOWN LIGHT FIXTURES
6. UPLIGHT MOUNTED IN HEADWALL.
7. INFANT WARMER SYSTEM.
8. SWITCH IS FOR INFANT WARMER SYSTEM.
9. INFANT RESUSCITATION SYSTEM.
10. FOLD DOWN BED.
11. ACCESSORY MOUNTING RAILS.
12. ADJUSTABLE SHELF.
13. AUTOMATIC EXHAUST FAN.
14. AUDIO/VISUAL TYPE NURSE CALL PATIENT STATION. PROVIDE CORD CONNECTED PATIENT CONTROL UNIT WITH NURSE CALL BUTTON, LIGHTING CONTROL, SPEAKER VOLUME AND TELEVISION CONTROL.
15. CONNECT RECEPTACLE TO CRITICAL BRANCH POWER SERVING THE PATIENT HEADWALL.
16. SWITCH CONTROLS CEILING MOUNTED LIGHT FIXTURE ABOVE ARMOIRE.
17. VACUUM SLIDE.

L & D - LDR/LDRP (Narrow) (LDRP1) 4.02.02

LABOR & DELIVERY/OB UNIT

ELEVATIONS

DATE: 01/28/2002

0 500 1000



1:30 SCALE (MILLIMETERS)

Medical Equipment Room Guide Plates

4.02 Labor & Delivery/OB Unit

Plate Number 4.02.02
Room Name L & D - LDR/LDRP (NARROW)
SEPS # LDRP1

JSN	Nomenclature	Qty	Army	Navy	AF	Utilities					
			Cat	Cat	Cat	1	2	3	4	5	6
A1066	Mirror, Float Glass, With SS Frame, 36X18	1	A	A	A	J
A1110	Headwall, Prefabricated, General, 1-2 bed	1	A	A	A	.	F	G	.	.	.
A5075	Dispenser, Soap, Disposable	1	C	C	C
A5080	Dispenser, Paper Towel, SS, Surface Mounted	1	A	A	A	J
A5106	Waste Disposal Unit, Sharps w/Glove Dispenser	3	C	A	C
A5145	Hook, Garment, Double, SS, Surface Mounted	2	A	A	A	J
A5180	Track, Cubicle, Surface Mounted, With Curtain	2	A	A	A	J
A6046	Artwork, Decorative, With Frame	1	C	C	C
A6305	Drapes, Pair	1	C	C	C
F0270	Chair, Rocking, High Back	1	C	C	C
F0315	Chair, Sleeper	1	C	C	C
F0340	Stool, Self Adjusting	1	C	C	C
F0400	Cabinet, Bedside, Door, Drawer, 31 x 21 x 19	1	C	C	C
F0550	Armoire, Resuscitation	1	A	A	A	.	A
F0560	Wardrobe, TV	1	C	C	C
F0725	Table, Occasional, Executive, Wood, 21 X 26 X 20	1	C	C	C
F2000	Basket, Wastepaper, Round, Metal, 18 H x 16 Dia.	1	C	C	C
F3200	Clock, Battery, 12" Diameter	1	C	C	C
M0430	Recorder / Player, Cassette, Video	1	C	C	C	.	A
M0500	Television, Color, 20" Diagonal	1	C	C	C	.	A
M0750	Flowmeter, Air, Connect w/50 PSI Supply	2	C	C	C	.	.	K	.	.	.
M0755	Flowmeter, Oxygen, Low Flow	2	C	C	C	.	.	A	.	.	.
M0765	Regulator, Vacuum	2	C	C	C	.	.	B	.	.	.
M1802	Wall Mounted, Fold Down Computer	1	C	C	C	.	A	.	.	.	J
M3005	Bassinet, w/Cart	1	C	C	C
M3070	Hamper, Linen, Mobile, w/Lid	1	C	C	C
M3072	Frame, Infectious Waste Bag w/Lid	1	C	C	C
M4100	Sphygmomanometer, Aneroid, Wall Mounted	1	C	C	C
M7000	Bed, Birthing, Electric	1	C	C	C	.	A
M7040	Table, Overbed	1	C	C	C
M7515	Light, Surgical, Ceiling Mtd, Birthing/Retractable	1	A	A	A	.	F
M7820	Monitor, Fetal, Bedside/Stand Alone	1	C	C	C	.	A	.	.	.	D
M7910	Thermometer, Electronic	1	C	C	C
P3100	Lavatory, Vitreous China, Slab Type	1	A	A	A	D

Medical Equipment Room Guide Plates

4.02 Labor & Delivery/OB Unit

Plate Number 4.02.02A
Room Name L & D - LDR/LDRP (NARROW) (EQUIP)
SEPS # LDRP1

JSN	Nomenclature	Qty	Army	Navy	AF	Utilities					
			Cat	Cat	Cat	1	2	3	4	5	6
E0963	Cart, General Storage, Mobile, 72"H x 23"W x 22"D	1	C	C	C
F0355	Footstool, Straight	1	C	C	C
M4116	Monitor, Vital Signs	1	C	C	C	.	A
M4255	Stand, IV, Adjustable	1	C	C	C
M4266	Pump, Volumetric, Infusion, Multiple Line	1	C	C	C	.	A
M7420	Light, Exam, Mobile	1	C	C	C	.	A
M8960	Cart, Surgical Case, Birthing Room	1	C	C	C
M8965	Cart, Fetal Monitoring, Birthing Room	1	C	C	C

Medical Equipment Room Guide Plates

4.02 Labor & Delivery/OB Unit

Plate Number 4.02.02B
Room Name L & D - LDR/LDRP (NARROW) (TLT/SHWR)
SEPS # LDRP1

JSN	Nomenclature	Qty	Army	Navy	AF	Utilities					
			Cat	Cat	Cat	1	2	3	4	5	6
A5030	Bench, Stall, Shower, Built In	1	A	A	A
A5047	Cabinet, Medicine, Bathroom	1	A	A	A
A5075	Dispenser, Soap, Disposable	1	C	C	C
A5080	Dispenser, Paper Towel, SS, Surface Mounted	1	A	A	A	J
A5090	Disposal, Sanitary Napkin, SS, Surface Mounted	1	A	A	A	J
A5109	Grab Bar, 1-1/4" Dia., SS, 2 Wall, W/C Accessible	1	A	A	A	J
A5110	Grab Bar, 1-1/4" Dia., SS, 2 Wall, Shower Use	1	A	A	A	J
A5145	Hook, Garment, Double, SS, Surface Mounted	3	A	A	A	J
A5165	Shelf, 5" Depth, SS, Surface Mounted	2	A	A	A	J
A5170	Rod, Shower Curtain, 1"Diameter, W/Curtain & Hooks	1	A	A	A	J
A5175	Soap Dish, With Bar, SS, Recessed	1	A	A	A
A5200	Dispenser, Toilet Tissue, SS, 2-Roll, Surface Mntd	1	A	A	A	J
F2000	Basket, Wastepaper, Round, Metal, 18 H x 16 Dia.	1	C	C	C
P3000	Lavatory, Vitreous China, Straight Back	1	A	A	A	D
P5040	Shower, Single, Hand-Held	1	A	A	A	D
P9050	Toilet, Wall Hung, Siphon Jet	1	A	A	A	B